




NOTES:

1. WHERE APPROVED BY TOWN AND ONLY WHERE THE WALKWAY SLOPE IS LESS THAN 4% AND WILL NOT BE USED BY MAINTENANCE VEHICLES, THE CONCRETE MAY BE REPLACED BY 50mm OF LIMESTONE SCREENINGS COMPACTED TO 98% SPD.
2. ALIGNMENT AND WIDTH OF WALKWAY TO BE APPROVED BY THE TOWN OF INNISFIL.
3. ALIGNMENT TO AVOID DISTURBANCE OF NATURAL TERRAIN AND MATURE TREES AS MUCH AS POSSIBLE.
4. EROSION AND SEDIMENT CONTROL DEVICES TO BE IN PLACE DURING CONSTRUCTION OF THE WALKWAY AND APPROVED BY THE TOWN OF INNISFIL.

1	REVISED TOWN LOGO	TOI	APRIL 2015
NO.	REVISIONS	APR'D	DATE

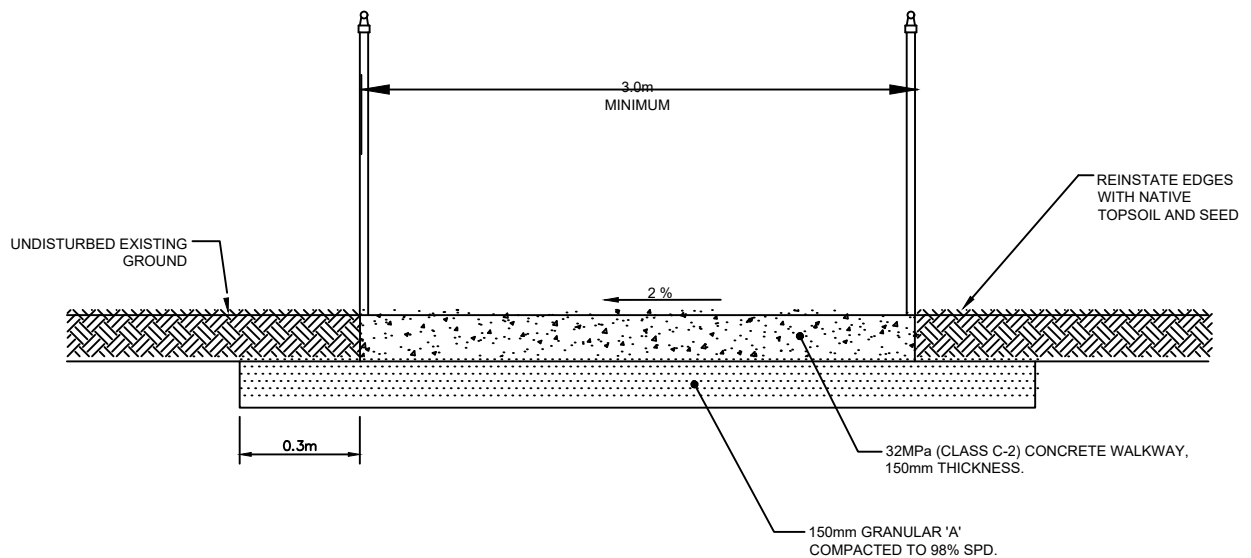

**PEDESTRIAN WALKWAY AND
PARK MAINTENANCE PATHWAY**

DRAWN: A&A

SCALE: N.T.S.

APR'D:

DATE: JUNE 2011

METRIC
ALL DIMENSIONS IN mm
UNLESS OTHERWISE NOTED

**TOISD
404**