




TYPICAL SILT FENCE SET-UP

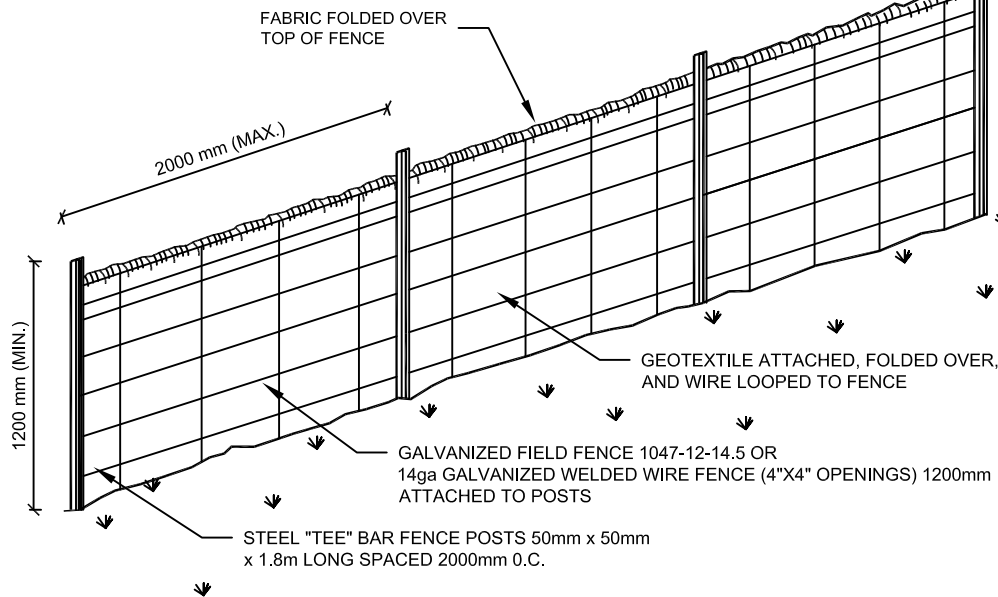

REPLACEMENT FENCE LOCATION

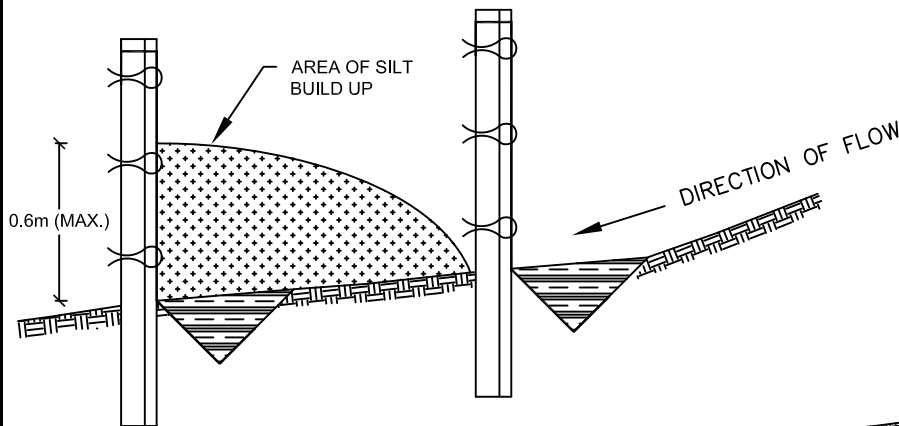

SILT FENCE PROFILE

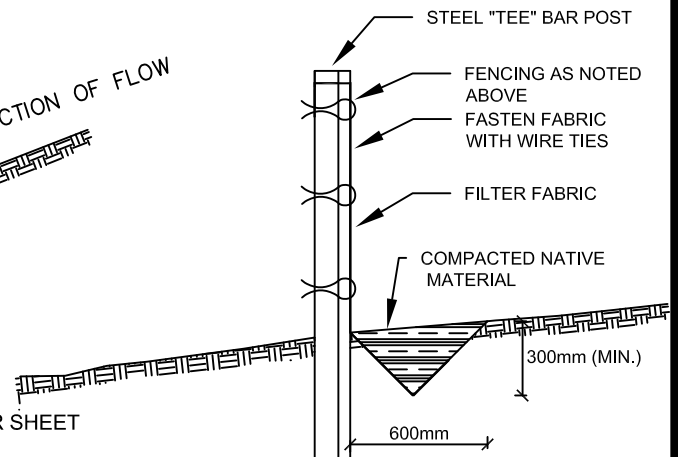

NOTES:

1. SILT CONTROL FENCE SHALL BE ALIGNED WITH CONTOURS FOR SHEET OVERLAND FLOW.
2. SILT CONTROL FENCE SHALL BE USED IN AREAS OF LOW SEDIMENT YIELD ON SLOPE THAT CONFORM TO MTO DRAINAGE MANUAL VOLUME 2 "CHART F4-3C TOPOGRAPHIC FACTOR LS BASED ON SLOPE LENGTH AND GRADIENT."
3. SILT CONTROL FENCE SHALL BE INSTALLED WITH FILTER FABRIC EXTENDING TO A HEIGHT OF 1200mm AND TOED INTO THE SOIL A MINIMUM DEPTH OF 300mm BY EITHER STATIC SLICING OR TRENCH METHODS WITH COMPACTION OF TRENCH MATERIAL MEETING 95% INSITU SOIL STRENGTH.
4. STEEL "TEE" BAR POSTS ARE TO BE SPACED MAX. 2.0m ON CENTRE.
5. FILTER FABRIC SHALL BE BACKFILLED WITH COMPACTED 19mm CRUSHER RUN LIMESTONE IN FROZEN CONDITIONS.
6. GEOTEXTILE FABRIC SHALL BE TERRATEX SD NON-WOVEN OR APPROVED EQUIVALENT COMPOSED OF NON-WOVEN U.V. STABILIZED MATERIAL.
7. FILTER FABRIC SHALL BE FOLDED OVER THE TOP OF THE FENCE AND FASTENED AT 300mm INTERVALS.

1.	REVISED NOTES	TOI	MAY 2019
NO.	REVISIONS	APR'D	DATE



SILTATION CONTROL FENCING

DRAWN: A&A

SCALE: N.T.S.

APR'D:

DATE: APRIL 2015

METRIC
ALL DIMENSIONS IN mm
UNLESS OTHERWISE NOTED

TOISD
503