




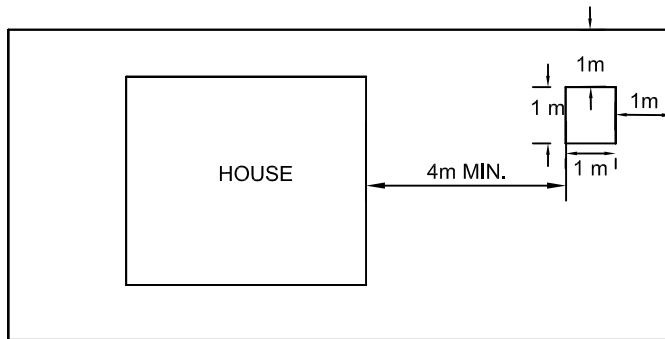

1. SOAKAWAY PITS ARE TO BE MIN 2M³ (2X1X1)
2. FILTER FABRIC IS TO ONLY BE LOCATED ON THE SIDES AND TOP OF THE PROPOSED PIT.
3. LARGE SOAKAWAY PITS MAY REQUIRE A PIPE HEADER AND MULTIPLE LEADERS IN THE PIT TO DISTRIBUTE RUNOFF
4. MINIMUM OFFSET FROM ANY PROPERTY LINE IS 1.0M. MINIMUM OFFSET FROM HOUSE IS 5.0M.

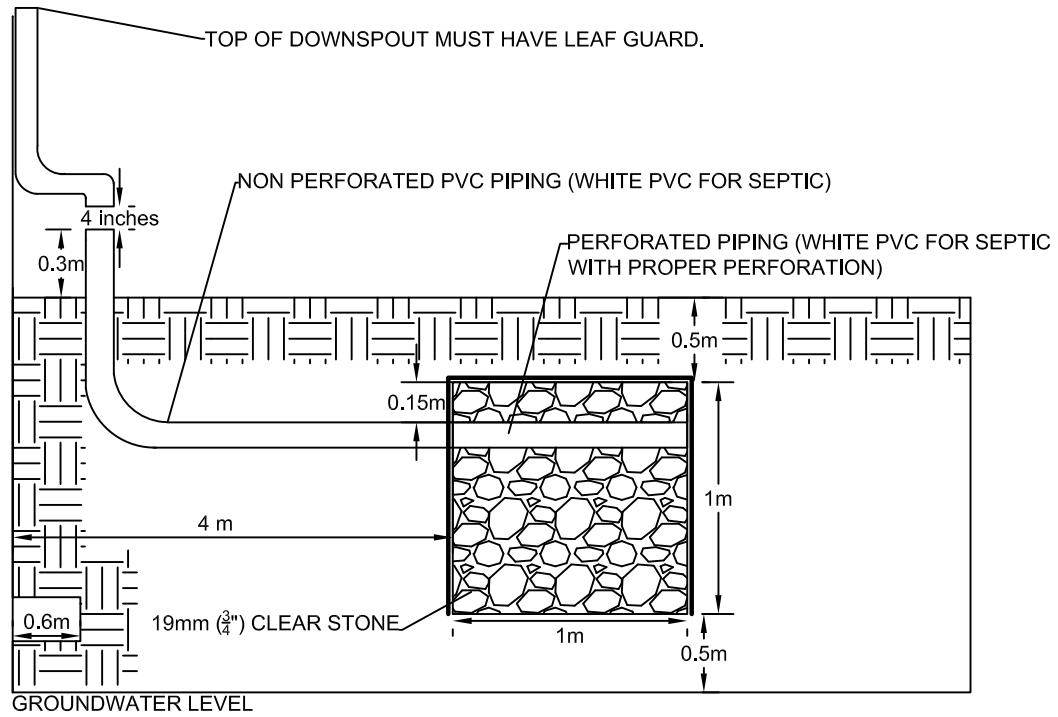

2.	ADDED NOTE 4, FILTER FABRIC	TOI	MAY 2019
1.	REVISED TO REFLECT OBC	TOI	APRIL 2018
NO.	REVISIONS	APR'D	DATE

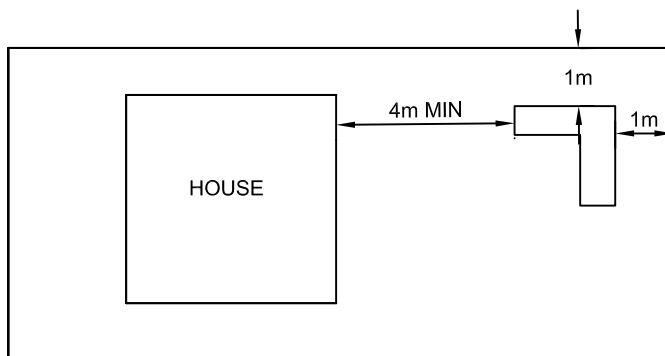

SOAKAWAY PIT DETAIL

DRAWN: A&A
SCALE: N.T.S.

APR'D:
DATE: APRIL 2015

METRIC
ALL DIMENSIONS IN mm
UNLESS OTHERWISE NOTED

**TOISD
506**