




NOTES

1. VALVE TO HAVE MECHANICAL JOINTS WITH RESTRAINERS.
2. PROVIDE BOND BREAKER BETWEEN CONCRETE AND VALVE BODY.
3. REFER TO TOWN DESIGN STANDARDS FOR APPROVED MATERIALS.
4. NO VALVES TO BE INSTALLED IN THE DRIVEWAY.

3.	DELETE TRACER WIRE TO SURFACE	TOI	MAY 2021
2.	TO REFLECT TOWN STANDARDS	TOI	APRIL 2018
1.	REVISED TOWN LOGO	TOI	APRIL 2015
NO.	REVISIONS	APR'D	DATE

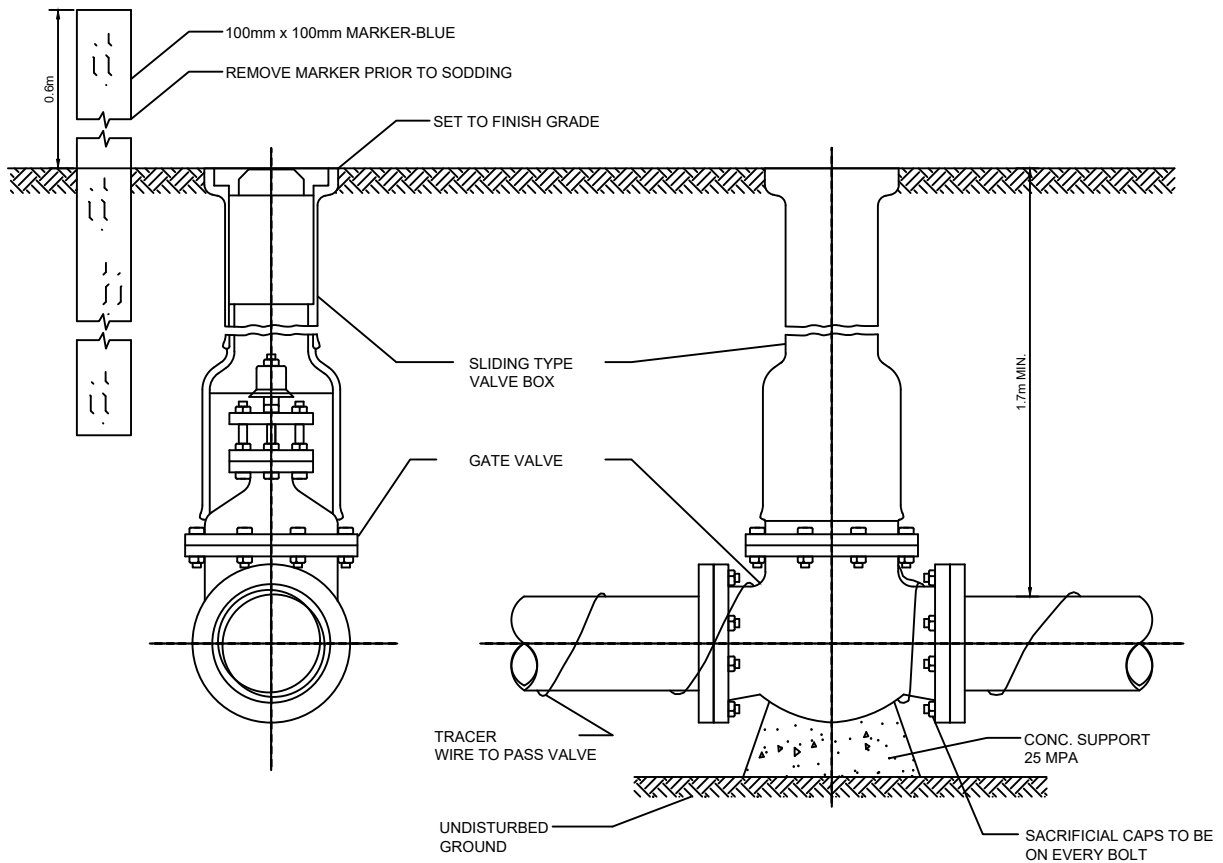

GATE VALVE AND EXTENDABLE VALVE BOX

DRAWN: A&A

APR'D:

SCALE: N.T.S.

DATE: JUNE 2011

METRIC
ALL DIMENSIONS IN mm
UNLESS OTHERWISE NOTED

**TOISD
701**