


NOTES

- 1. NO BENDS OR COUPLING ARE PERMITTED BETWEEN THE MAIN STOP AND THE CURB STOP
- 2. FOR 25mm Ø SERVICE, MAINSTOP SHALL BE 45° TO HORIZONTAL AND GOOSENECK SHALL BE VERTICAL.
- 3. APPROVED CATHODIC PROTECTION SHALL BE USED WHERE REQUIRED BY THE TOWN.
- 4. ALL MARKERS TO BE REMOVED AS DIRECTED BY THE TOWN.
- 5. FOR 38mm AND 50mm DIAMETER SERVICES, MAIN STOP SHALL BE AT 0 DEGREES TO HORIZONTAL.
- 6. ANODE MUST BE SUPPLIED WITHIN A 3m #10 COPPER WIRE WITH THW INSULATION. CONNECT ANODE WIRE TO WATER SERVICE WITH GROUND CLAMP, WRAPPED IN CORROSION TAPE. ANODE TO BE INSTALLED HORIZONTALLY AT SERVICE DEPTH, MINIMUM 0.6m TO THE SIDE OF SERVICE, PLACED IN NATIVE SOIL.
- 7. FOR SHORT WATER SERVICES (LESS THAN 5 METRES), ONE ANODE REQUIRED NEAR MAIN STOP. FOR LONG WATER SERVICES (5 METRES OR GREATER), ANODE REQUIRED NEAR MAIN STOP AND ANODE REQUIRED NEAR CURB STOP

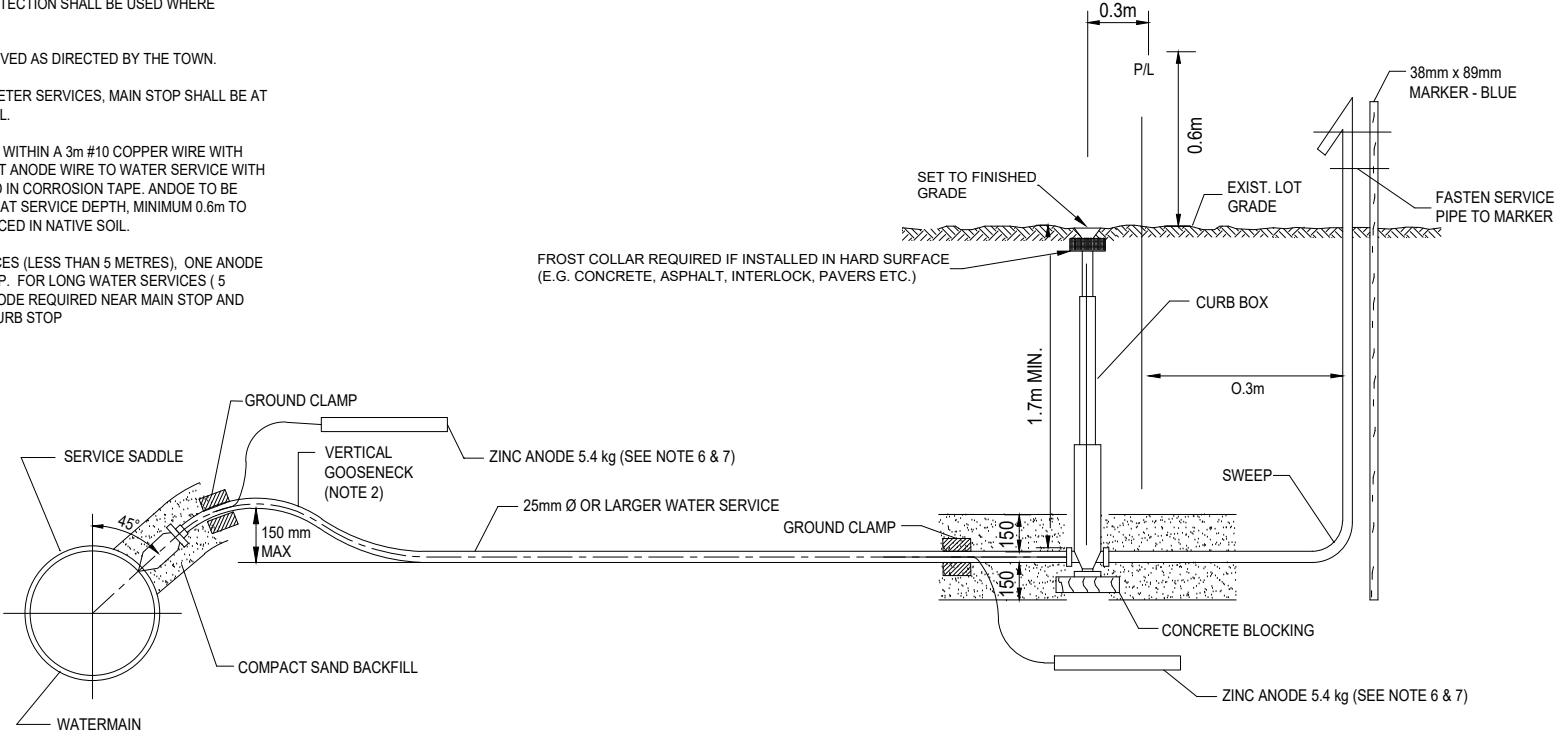

COPPER WATER SERVICE
CONNECTION DETAIL
25mm OR LARGER DIAMETER SIZES

DRAWN:	APR'D:				
SCALE: N.T.S.	DATE: SEPT 2025	NO.	REVISIONS	APR'D	DATE

METRIC
ALL DIMENSIONS IN mm
UNLESS OTHERWISE NOTED

TOISD
705