



NOTES

- 1. NO BENDS OR COUPLING ARE PERMITTED BETWEEN THE MAIN STOP AND THE CURB STOP
- 2. MAINSTOP SHALL BE 20° TO HORIZONTAL AND GOOSENECK SHALL BE HORIZONTAL.
- 3. PEX WATER SERVICES WILL NOT BE PERMITTED IN SOILS CONTAMINATED WITH HYDROCARBONS, CHEMICALS OR OTHER POSSIBLE HAZARDS
- 4. TRACER WIRE TO RUN BETWEEN THE SHOULDER SET SCREW ON THE MAIN STOP TO SHOULDER SET SCREW ON THE CURB STOP. NO SPLICES IN TRACER WIRE ALLOWED.
- 5. PROFILING MASTIC SHALL BE USED TO PACK ANY VOIDS IN THE SHOULDER SET SCREW. PETROLATUM TAPE TO THEN BE WRAPPED AROUND THE CONNECTION.
- 6. TRACER WIRE ON THE PRIVATE SIDE SHALL NOT BE CONNECTED TO THE TRACER WIRE OR ANY INFRASTRUCTURE ON THE MUNICIPAL SIDE.

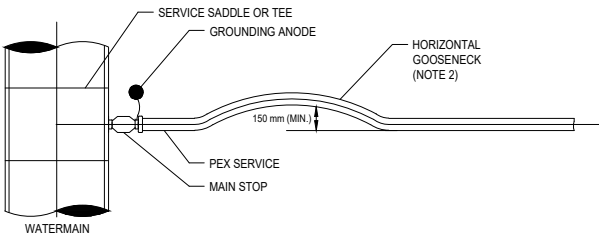

PLAN VIEW

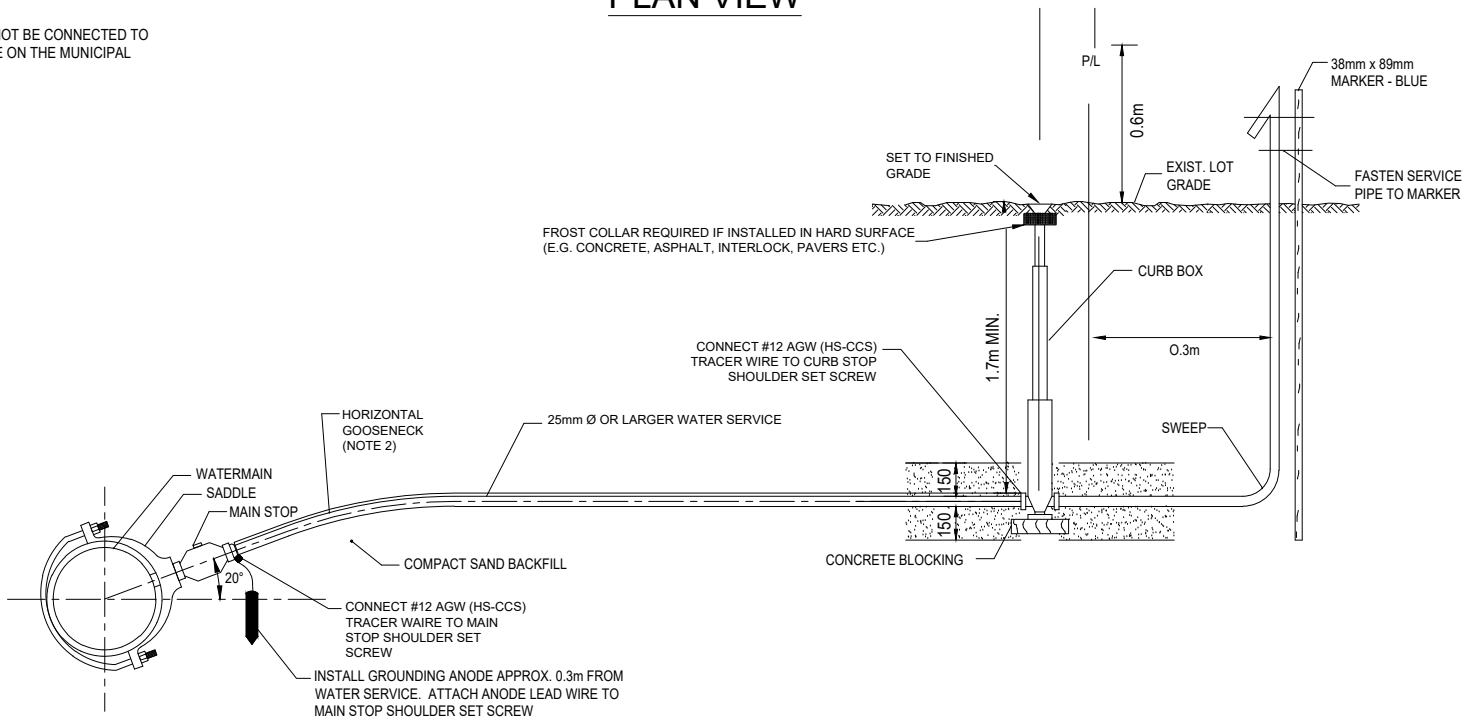

CROSS-LINKED POLYETHYLENE
(PEX) WATER SERVICE
CONNECTION DETAIL
25mm or LARGER DIAMETER SIZES

DRAWN:	APR'D:				
SCALE: N.T.S.	DATE: SEPT 2025	NO.	REVISIONS	APR'D	DATE

METRIC
ALL DIMENSIONS IN mm
UNLESS OTHERWISE NOTED

TOISD
705A