


SIDE VIEW

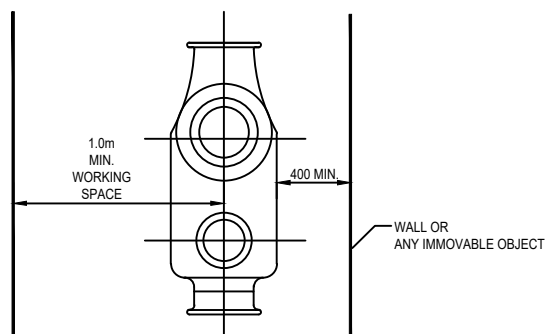

**TOP VIEW
OF METER**

NOTES

1. USE 50mm GATE VALVE AND PLUG FOR TESTING WHERE REQUIRED.
- 1.A. WATER METER AND VALVES REQUIRE SUPPORTS TO INNSERVICES SATISFACTION. PIPE SUPPORTS TO CONFORM TO PART 7 OF THE OBC.
- 1.B. FLANGED FITTINGS ARE REQUIRED FOR ALL COMPOUND METERS.
- 1.C. BY-PASS LINE SIZE TO BE SAME AS METER LINE.
- 1.D. WORKING SPACE IN FRONT OF METER MUST HAVE 2.0m HEAD CLEARANCE.
- 1.E. BACKFLOW PREVENTER REQUIRED BEYOND THE BY-PASS. BACKFLOW PREVENTOR TO BE DETERMINED BY A QUALIFIED PERSON IN ACCORDANCE WITH THE INNISFIL BACKFLOW PREVENTION BY-LAW, AND IN ACCORDANCE WITH CSA B64 SERIES.
- 1.F. EXPANSION TANK REQUIRED BEYOND THE BACKFLOW PREVENTER AS PER PART 7 OF THE OBC.
- 1.G. PRESSURE REDUCING VALVES, IF REQUIRED, MUST BE LOCATED BEYOND THE BY-PASS AND BACKFLOW PREVENTER.

3.	REVISE NOTES	TOI	SEPT 2025
2.	TO REFLECT TOWN STANDARDS	TOI	APRIL 2018
1.	REVISED TOWN LOGO	TOI	APRIL 2015
NO.	REVISIONS	APR'D	DATE



**INSTALLATION DETAILS FOR
COMPOUND WATER METER**

METRIC
ALL DIMENSIONS IN mm
UNLESS OTHERWISE NOTED

**TOISD
707**

DRAWN:

APR'D:

SCALE: N.T.S.

DATE: JUNE 2011