




NOTES

1. REFER TO TOWN DESIGN STANDARDS FOR APPROVED MATERIALS.
2. SAMPLING STATIONS SHALL BE PEDESTAL STYLE FOR FREEZING CLIMATES, ENCLOSED IN A NONREMOVABLE PVC HOUSING, EQUIPPED WITH A LOCKABLE ACCESS DOOR.
3. WHEN OPENED, THE STATION SHALL REQUIRE NO KEY FOR OPERATION, AND THE WATER WILL FLOW IN AN ALL STAINLESS STEEL WATERWAY.
4. ALL WORKING PARTS WILL ALSO BE OF BRASS AND BE REMOVABLE FROM ABOVE GROUND WITH NO DIGGING. EXTERIOR PIPING SHALL BE GALVANIZED STEEL (BRASS PIPE ALSO AVAILABLE).
5. A COPPER VENT TUBE WILL ENABLE EACH STATION TO BE PUMPED FREE OF STANDING WATER TO PREVENT FREEZING AND TO MINIMIZE BACTERIA GROWTH.

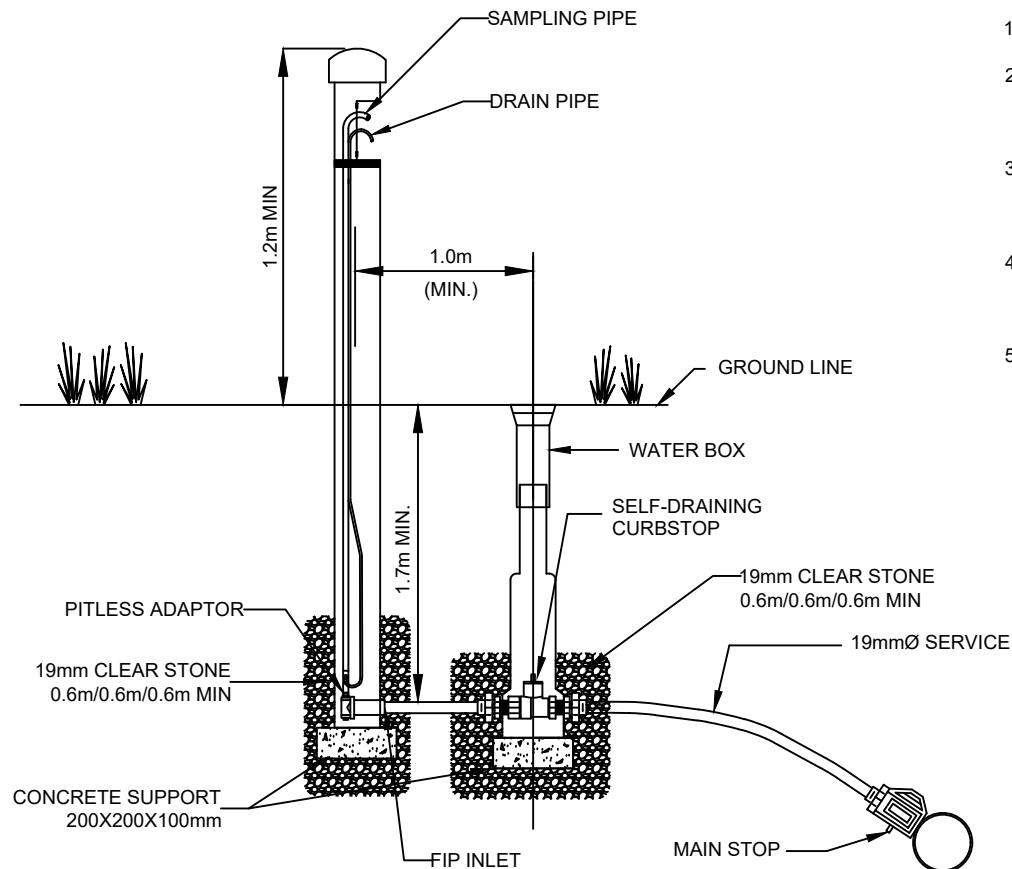

SAMPLING STATION INSTALLATION

DRAWN: A&A

APR'D:

SCALE: N.T.S.

DATE: JUNE 2011

3.	TO REFLECT TOWN STANDARDS	TOI	APRIL 2018
2.	TO REFLECT TOWN STANDARDS	TOI	MAY 2016
1.	REVISED TOWN LOGO	TOI	APRIL 2015
NO.	REVISIONS	APR'D	DATE

METRIC
ALL DIMENSIONS IN mm
UNLESS OTHERWISE NOTED

TOISD
711