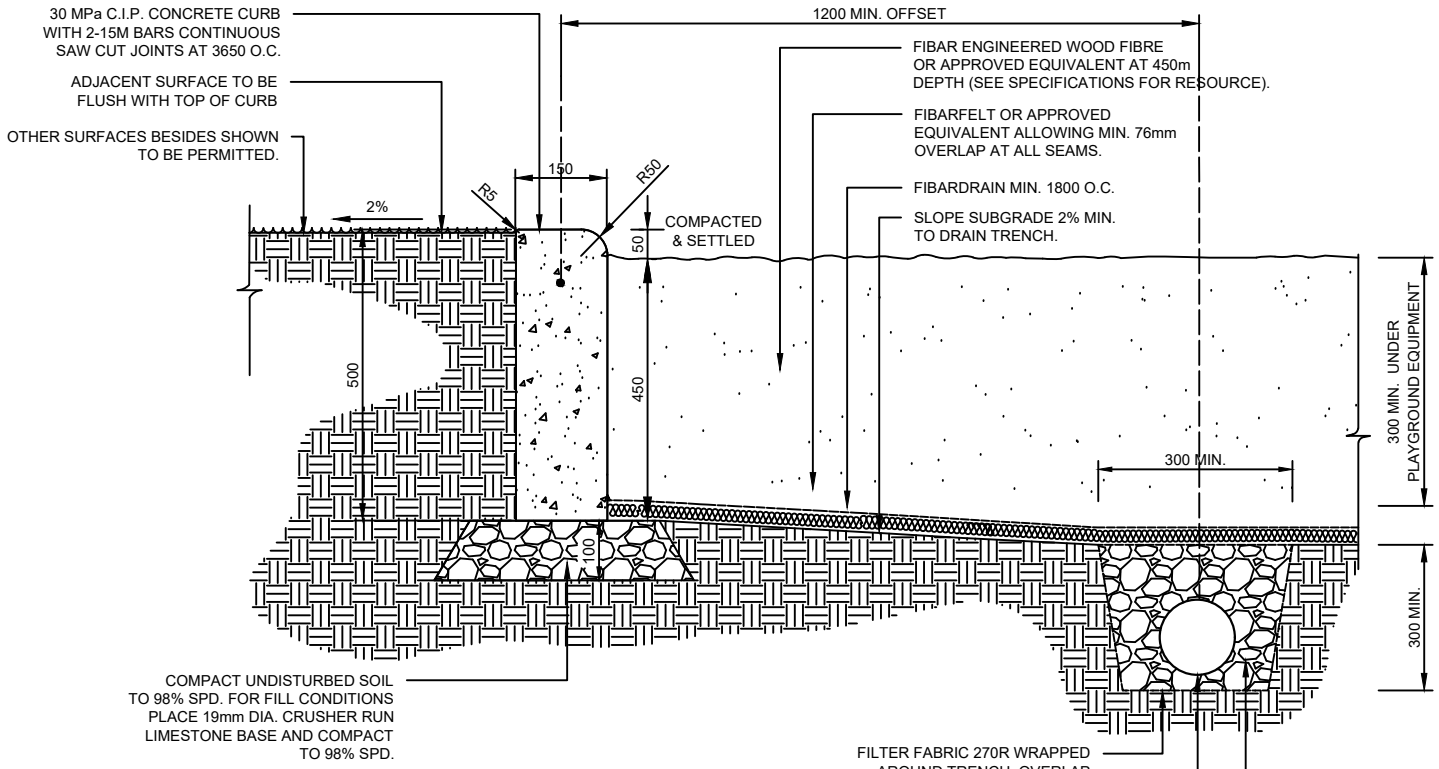

NOTES:

1. THE PLAY SURFACE AND DRAINAGE SYSTEM SHOULD BE FIBAR 300 SYSTEM OR APPROVED EQUIVALENT.
2. PLAY SURFACE MATERIAL SHALL BE INSTALLED AND COMPACTED IN TWO SEPARATE LAYERS OF EQUAL COMPACTED THICKNESS.
3. 100 DIA. RIGID PVC PIPE CONNECTION FROM PLAYGROUND CURB TO C.B.
4. CONTRACTOR TO MAINTAIN WOOD FIBER LEVEL UNTIL FINAL ACCEPTANCE.
5. ALL MEASUREMENTS ARE IN MILLIMETRES UNLESS STATED OTHERWISE.

Innisfil

PLAY AREA (ENGINEERED WOOD SURFACE) C.I.P. CONCRETE CURB (SECTION)

DRAWN: D.S.L.	APR'D:	1.	TO REFLECT TOWN STANDARDS	TOI	APRIL 2018
SCALE: N.T.S.	DATE: APRIL 2016	NO.	REVISIONS	APR'D	DATE

METRIC
ALL DIMENSIONS IN mm
UNLESS OTHERWISE NOTED

TOISD
821